
15A NCAC .1700 Rules Decision Diagram
Environmental Health Services Section

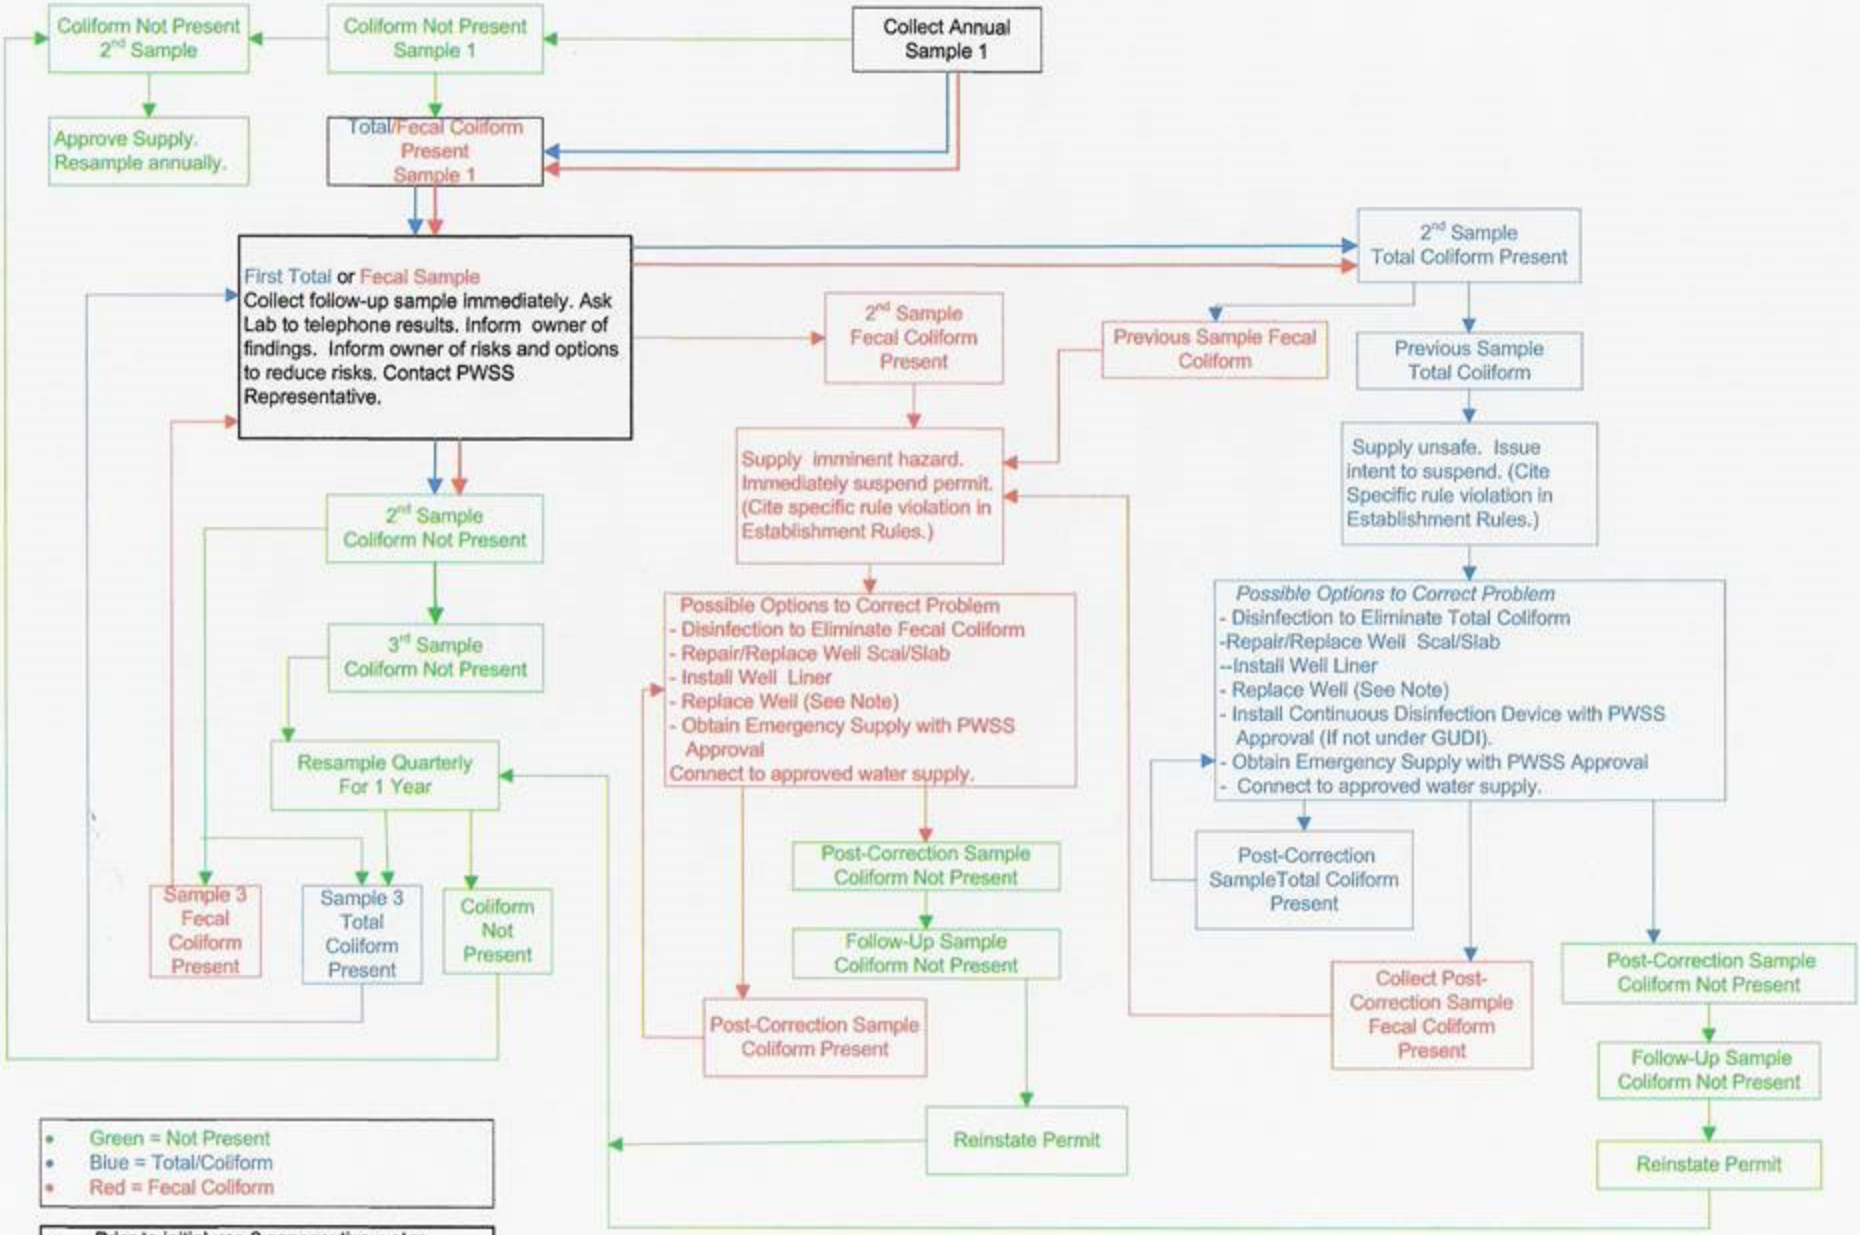


- Green = Not Present
- Blue = Total/Coliform
- Red = Fecal Coliform

- Prior to initial use 2 consecutive water samples taken at least 48 hours apart shall be taken.
- Prior to collection of each sample the water shall be tested negative for chlorine residual.

9:51:21 AMTuesday, June 22, 2004